

APPENDIX C

Facility Inspections

0.69/248C/1

0.69/248C/1

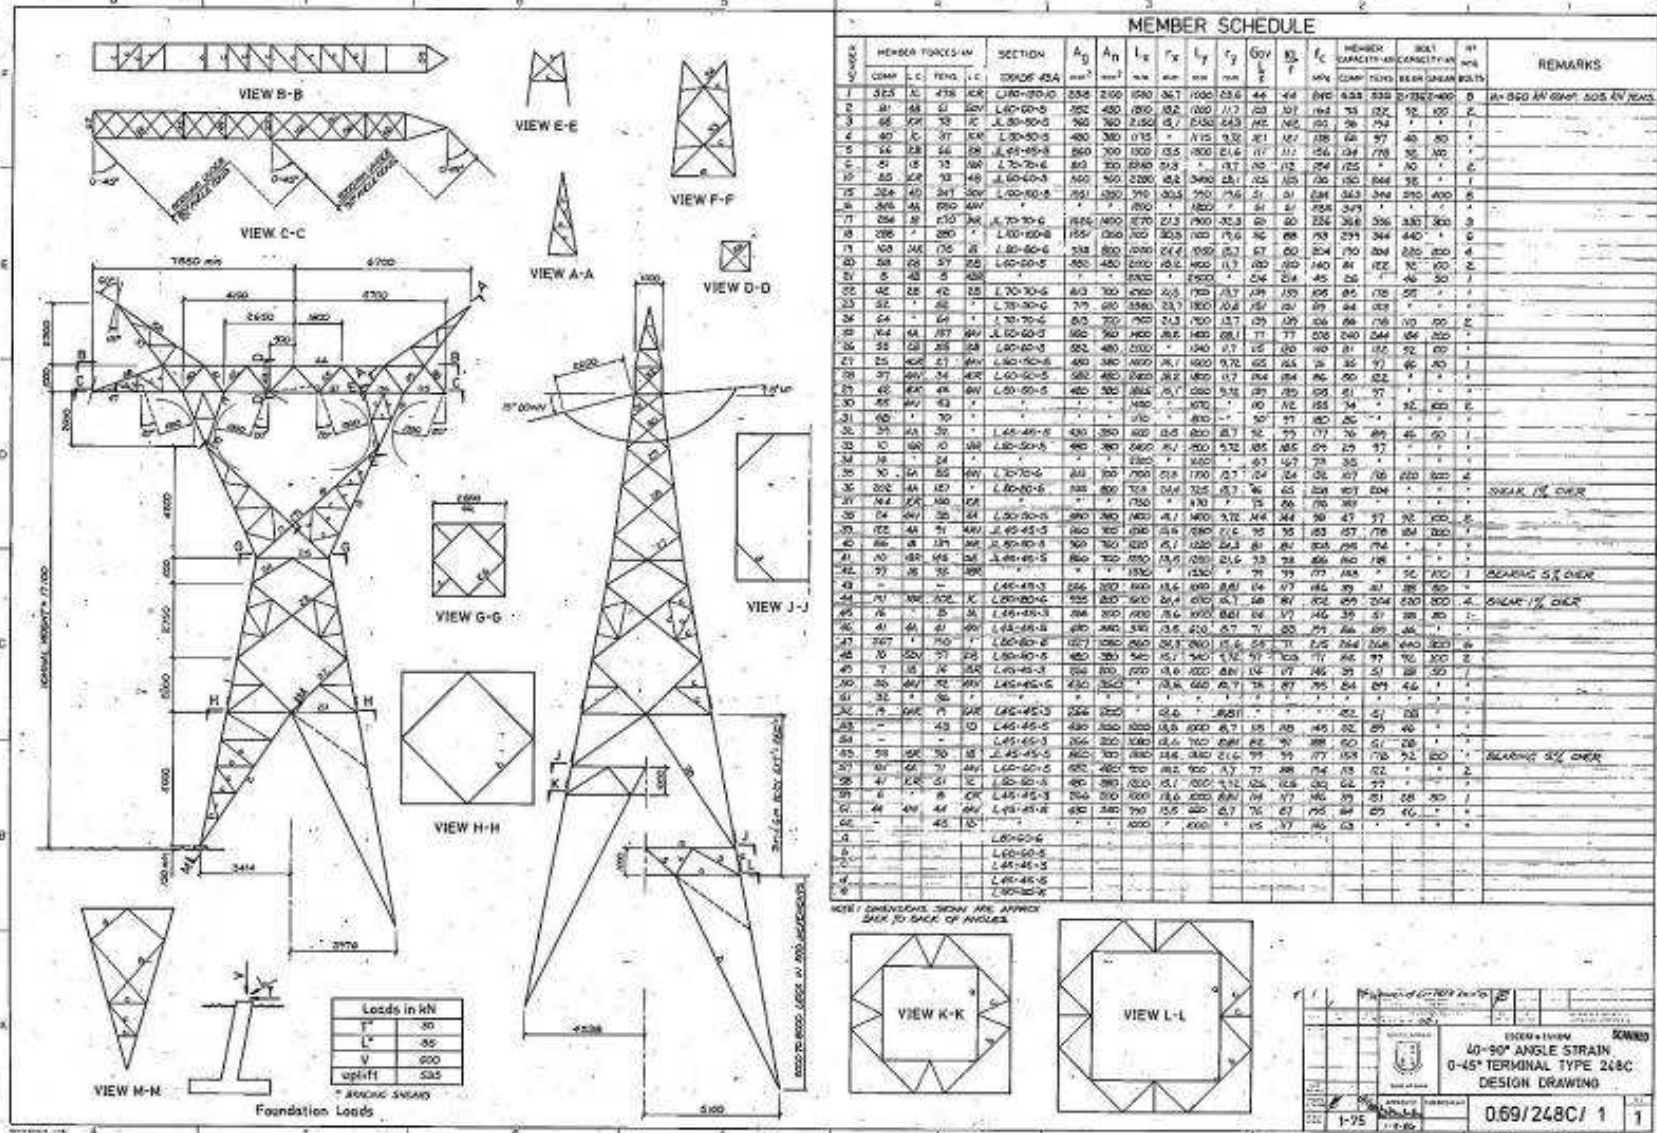


Figure 10. Lattice tower structure 248C

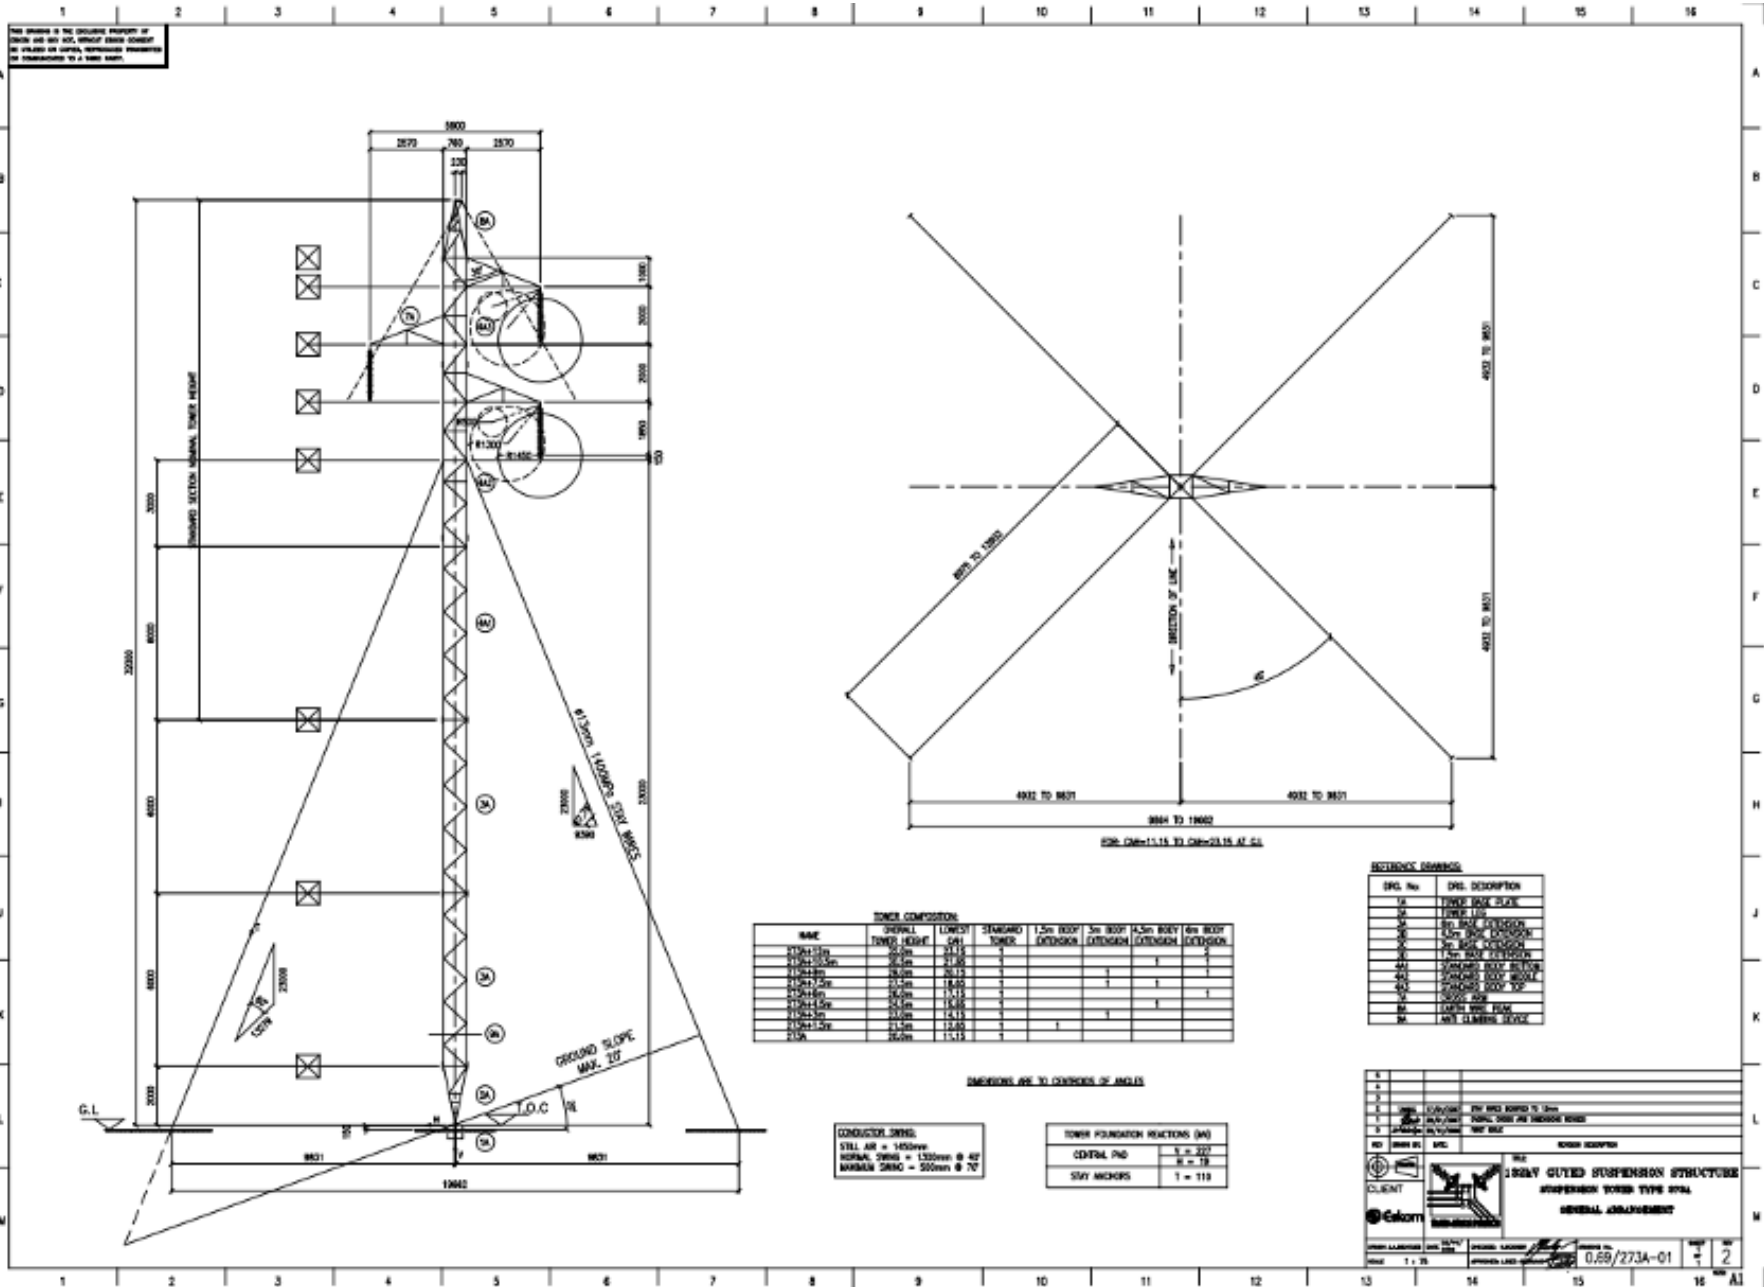


Figure 11: Guyed lattice mast tower 273A.

0-69/255A/1

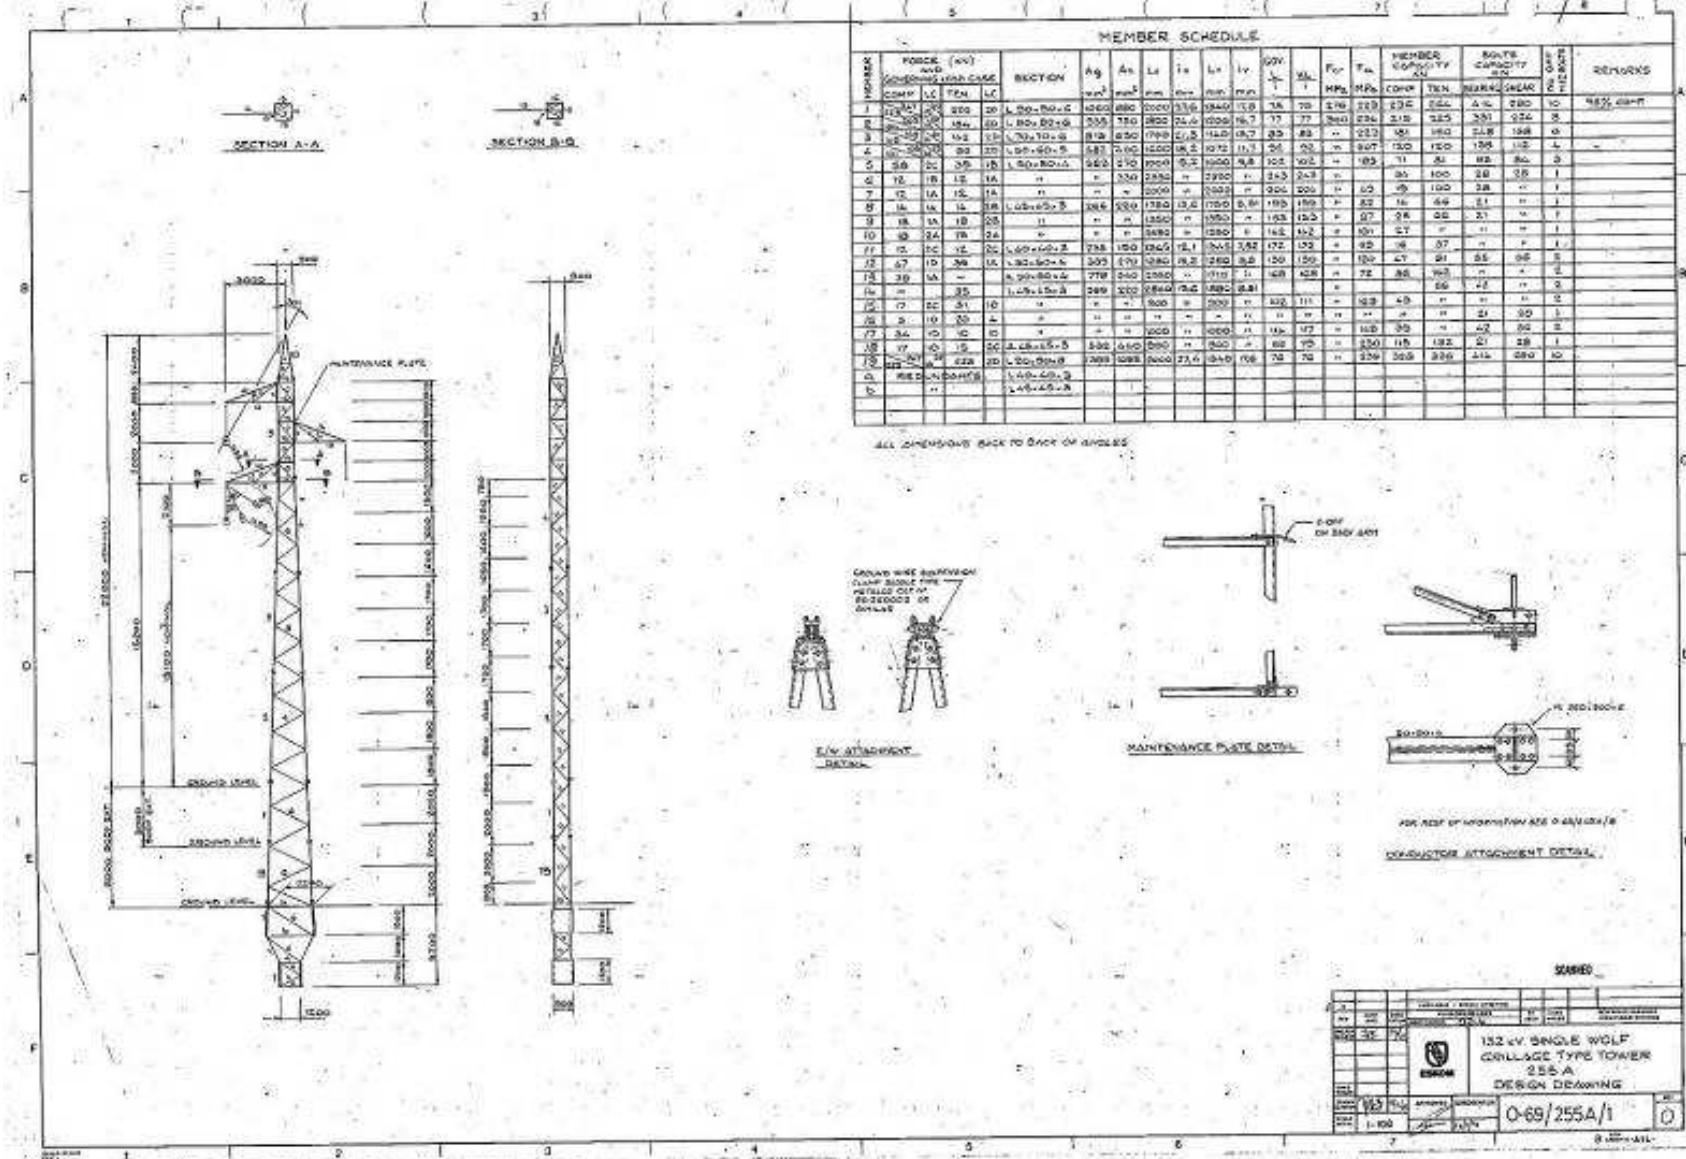


Figure 12. Lattice tower structure 255A.

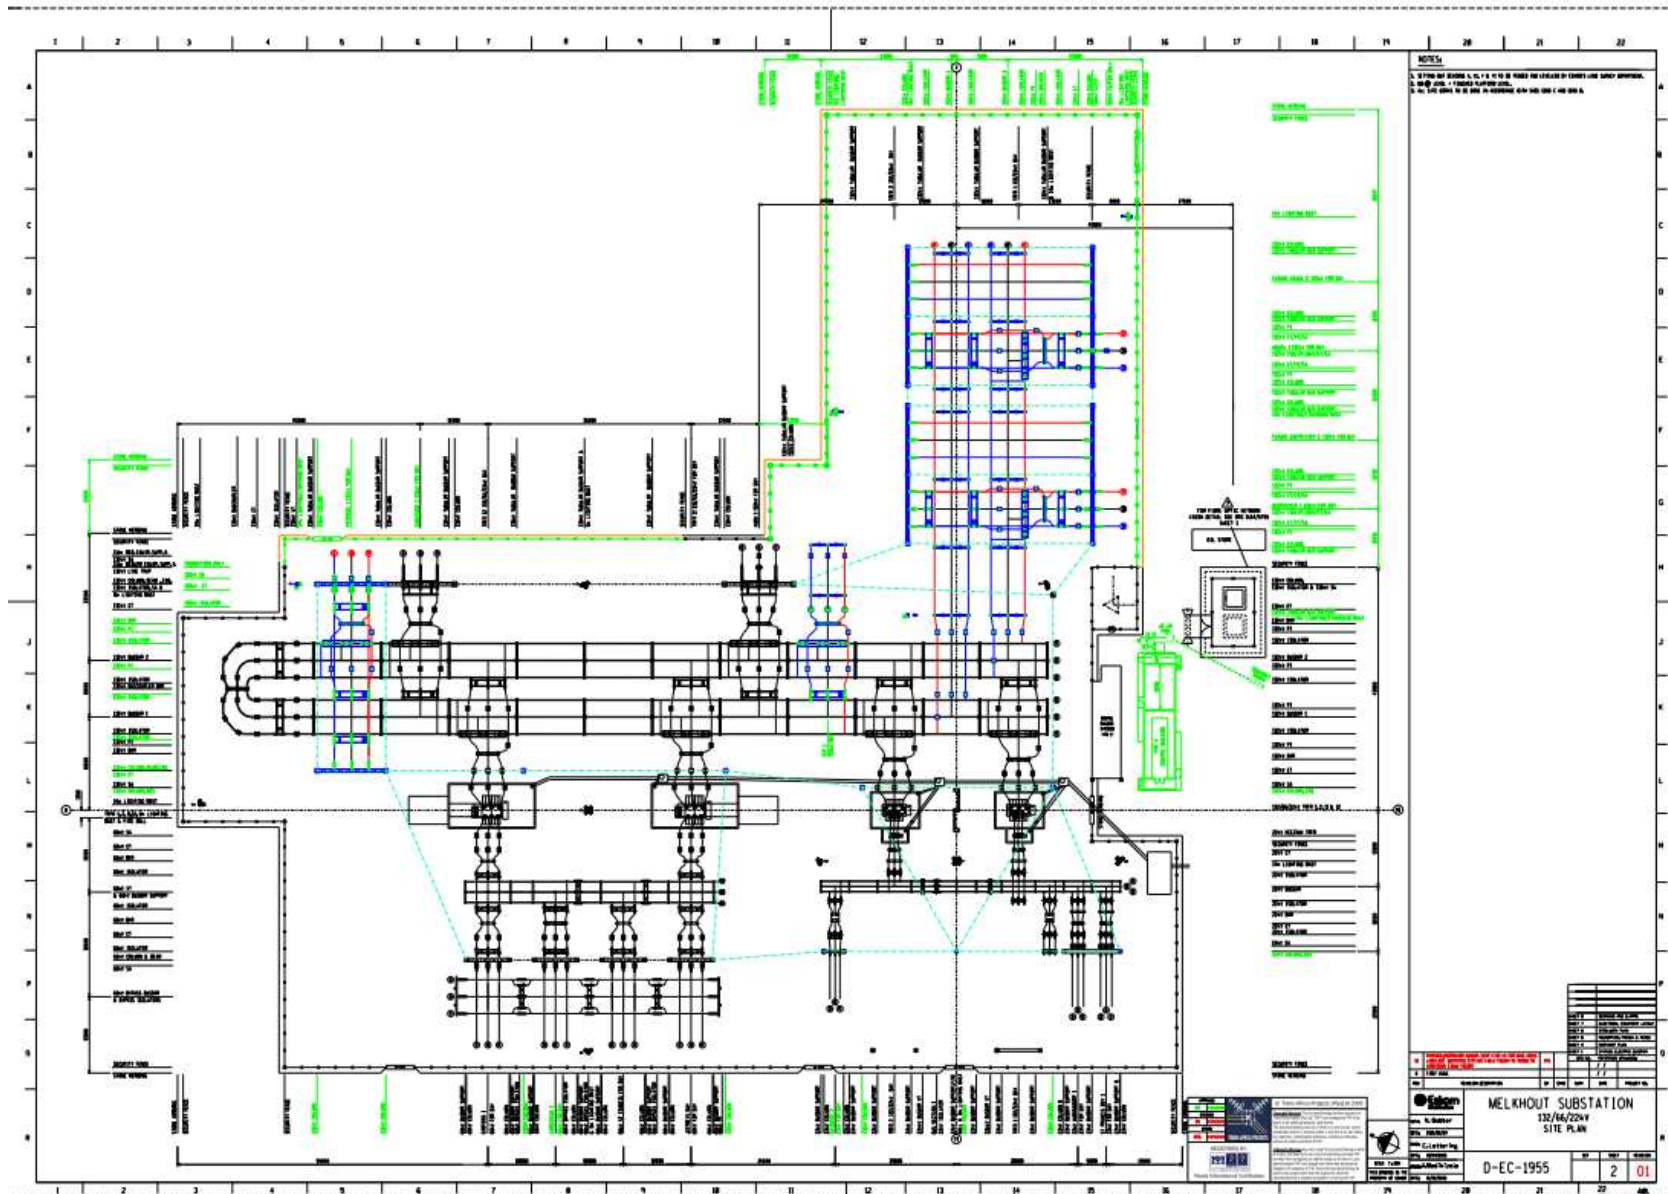


Figure 14. Layout plan for the extensions to the existing Melkhout Substation.

